









Signature Hygiene Rim BTW with SpaLet E-Bidet Seat AS01032



American Standard





**CCAS3141-
3W20411R0**

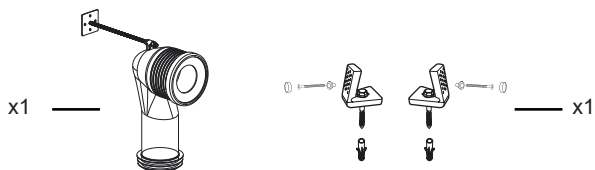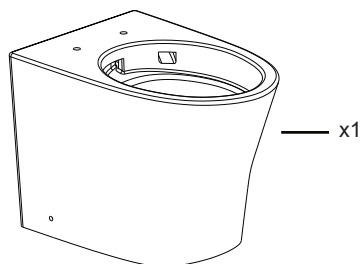

**CL6155M-
6D**






**CEAS7SS1-
0100510R0**




















w/ normal S&C

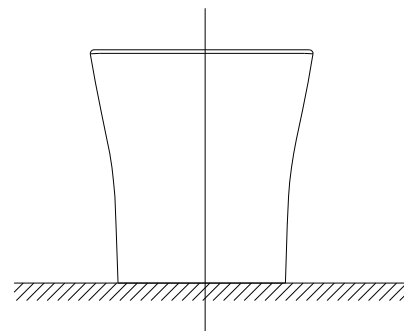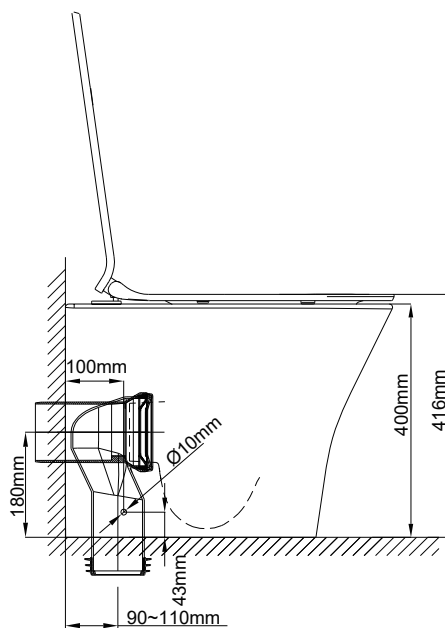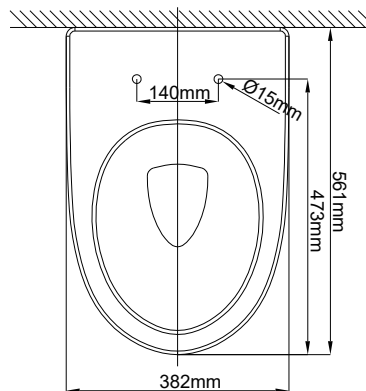


w/ Spalet E-bidet

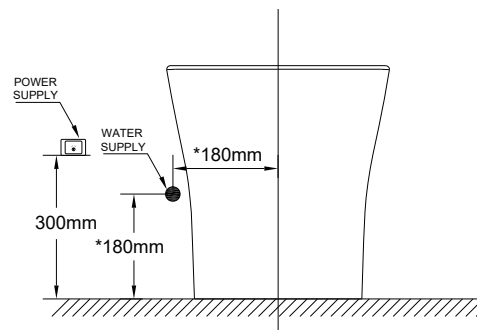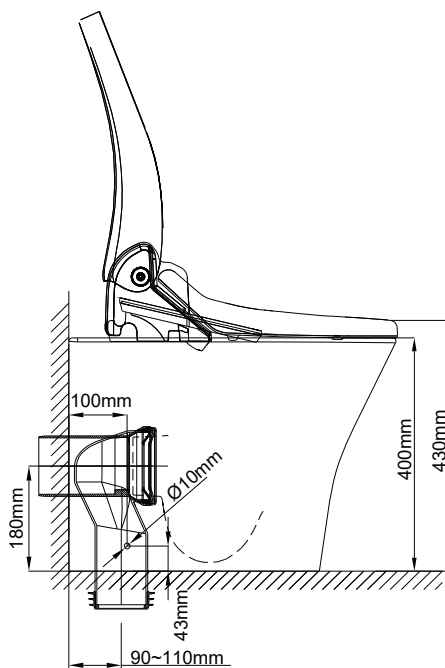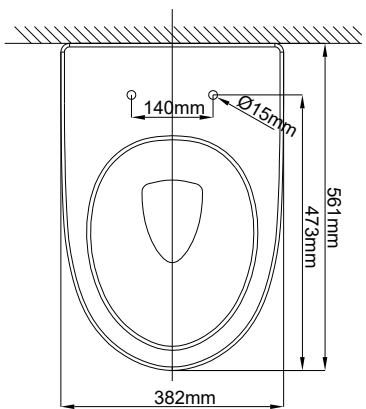


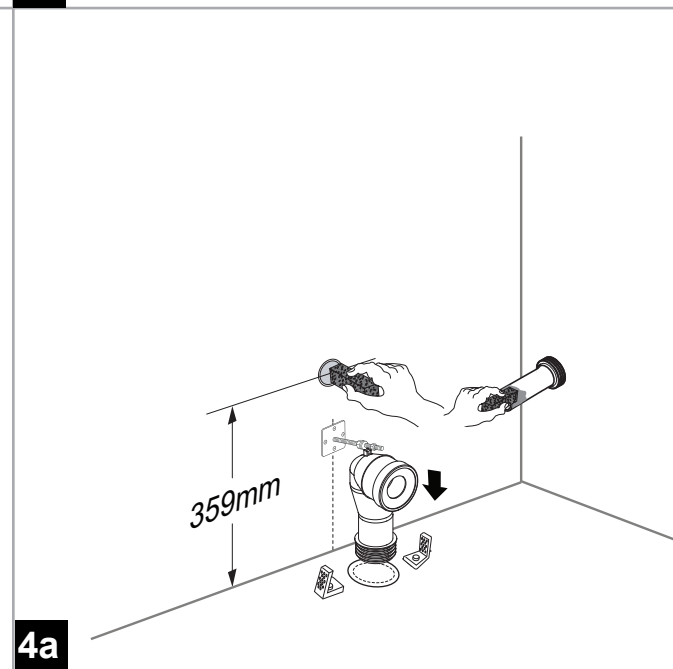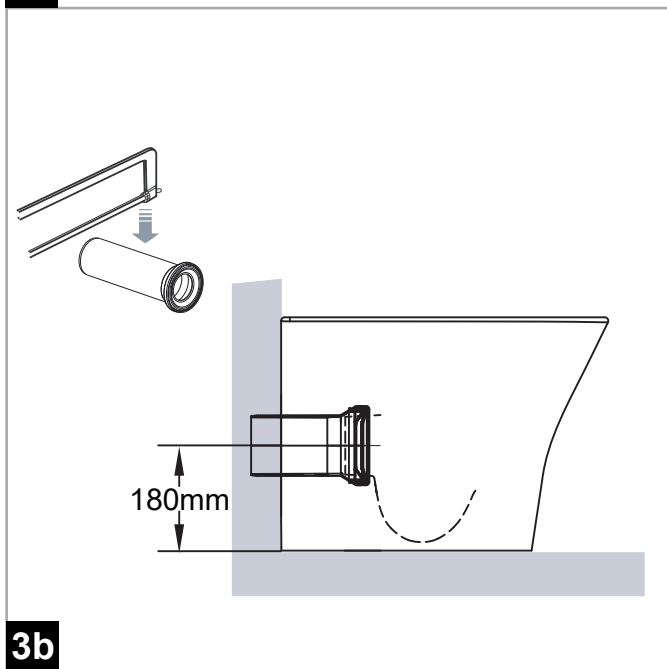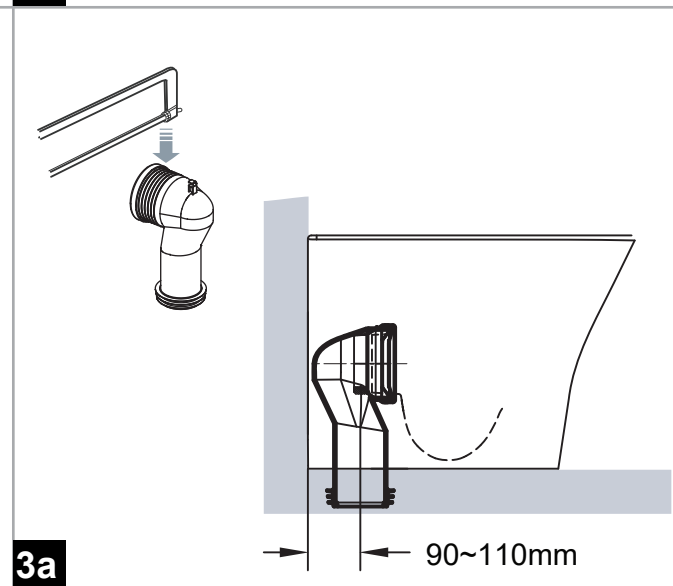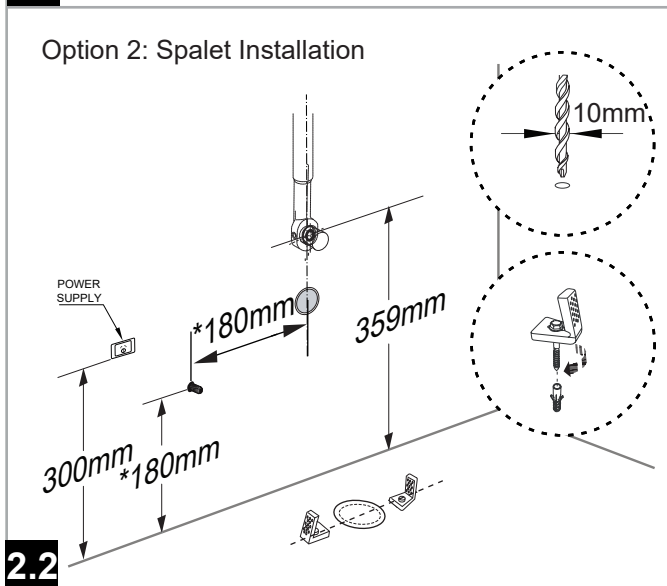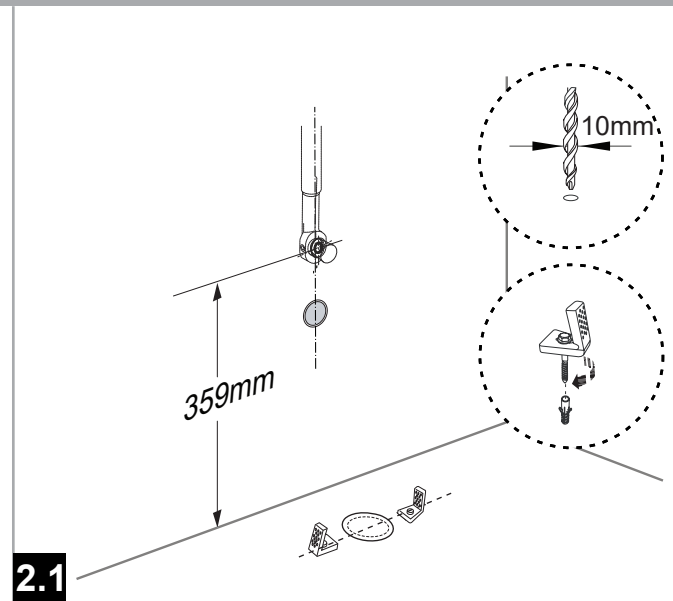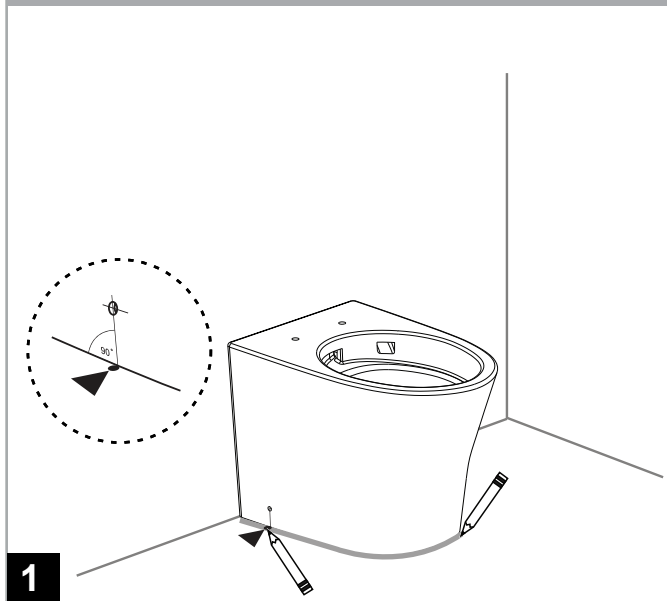

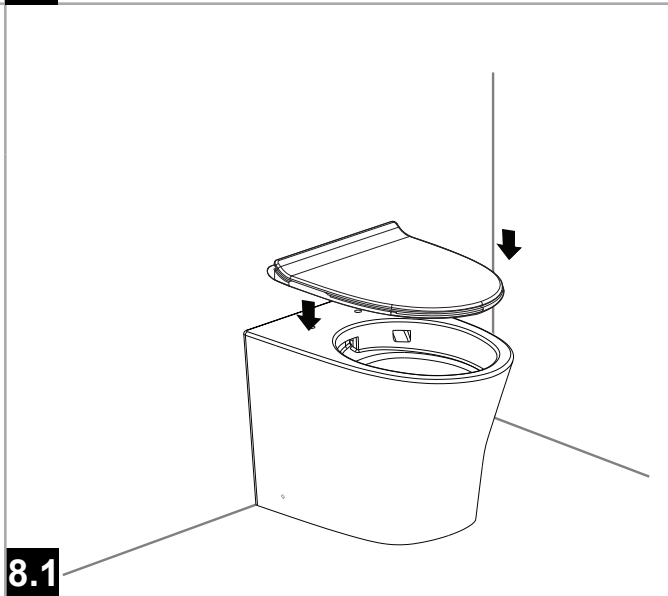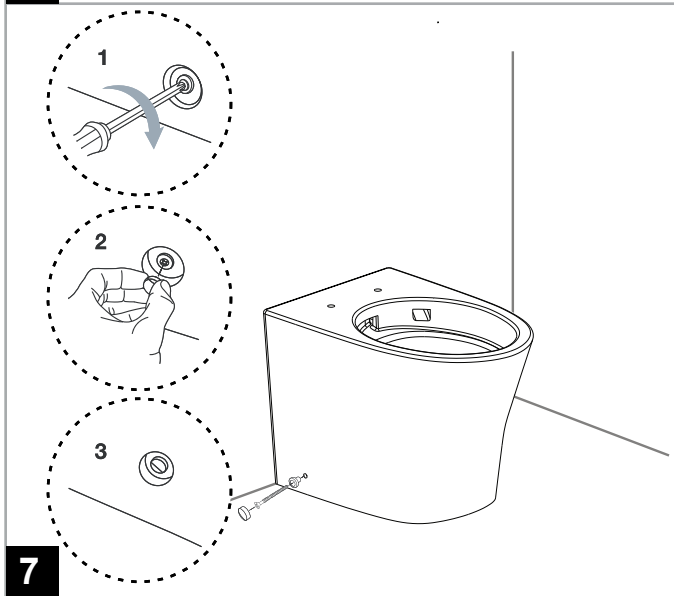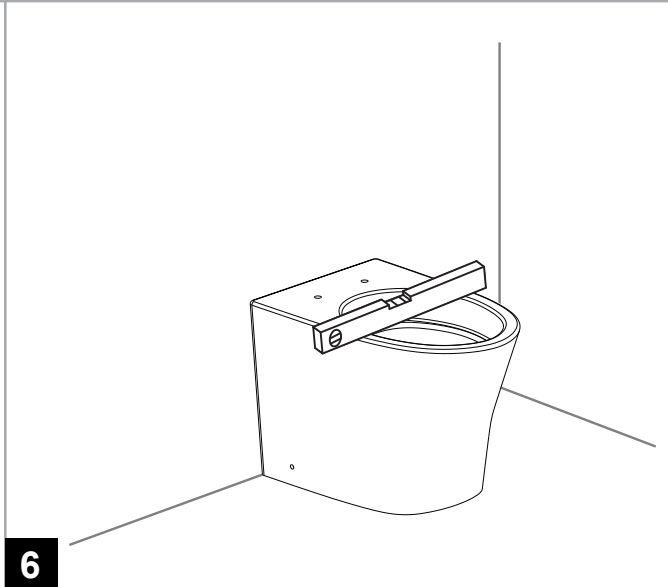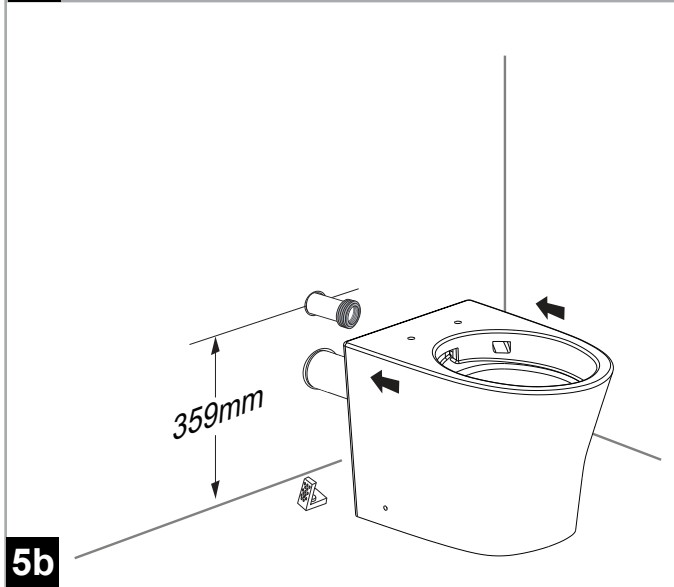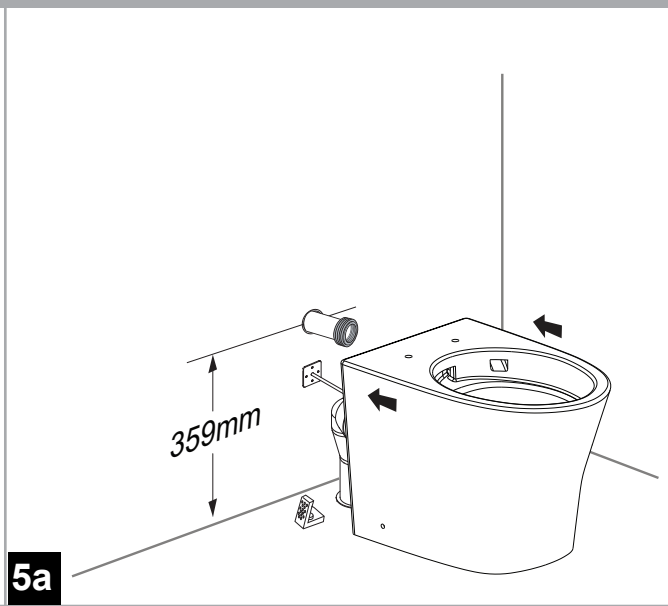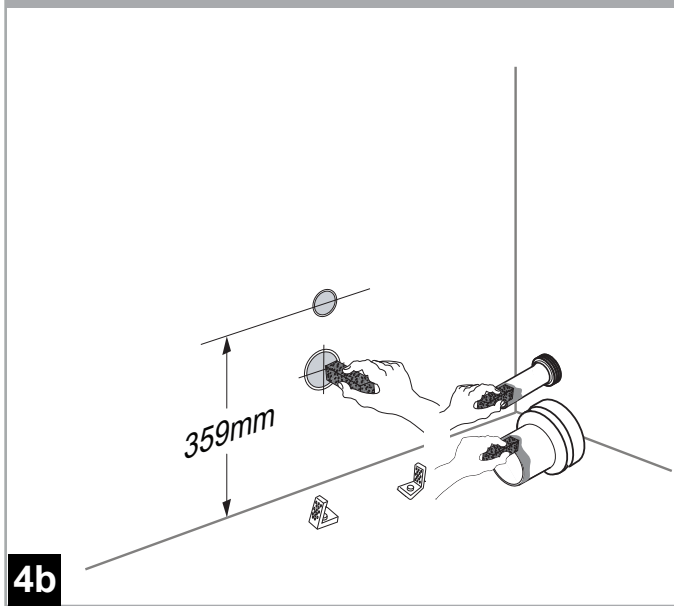


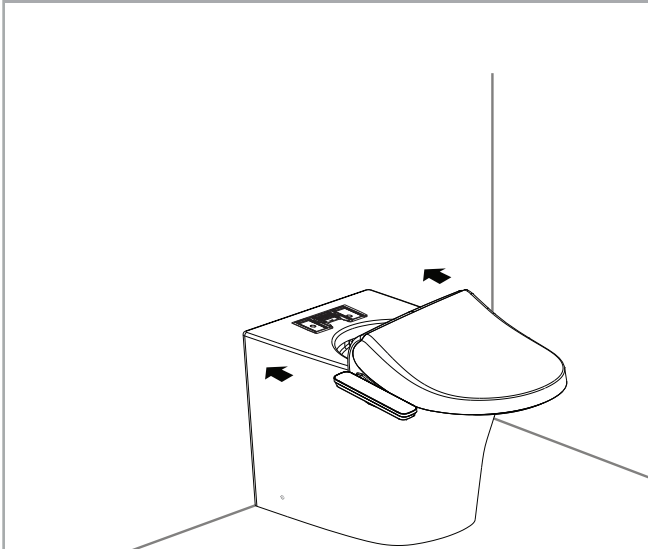

8.2

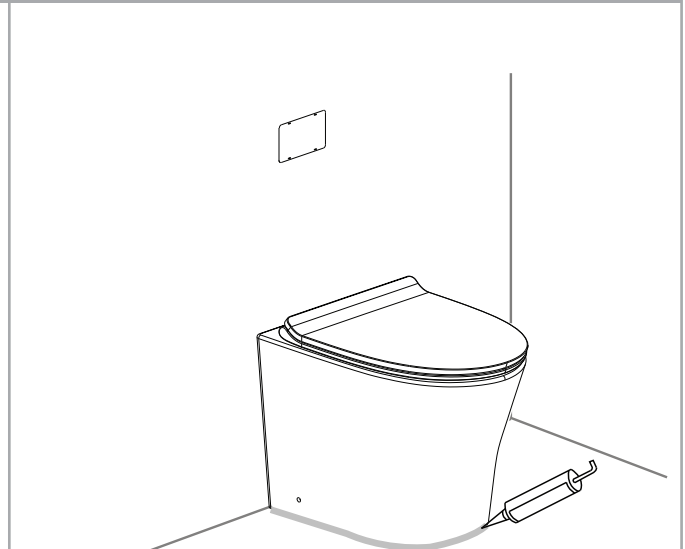

9.1

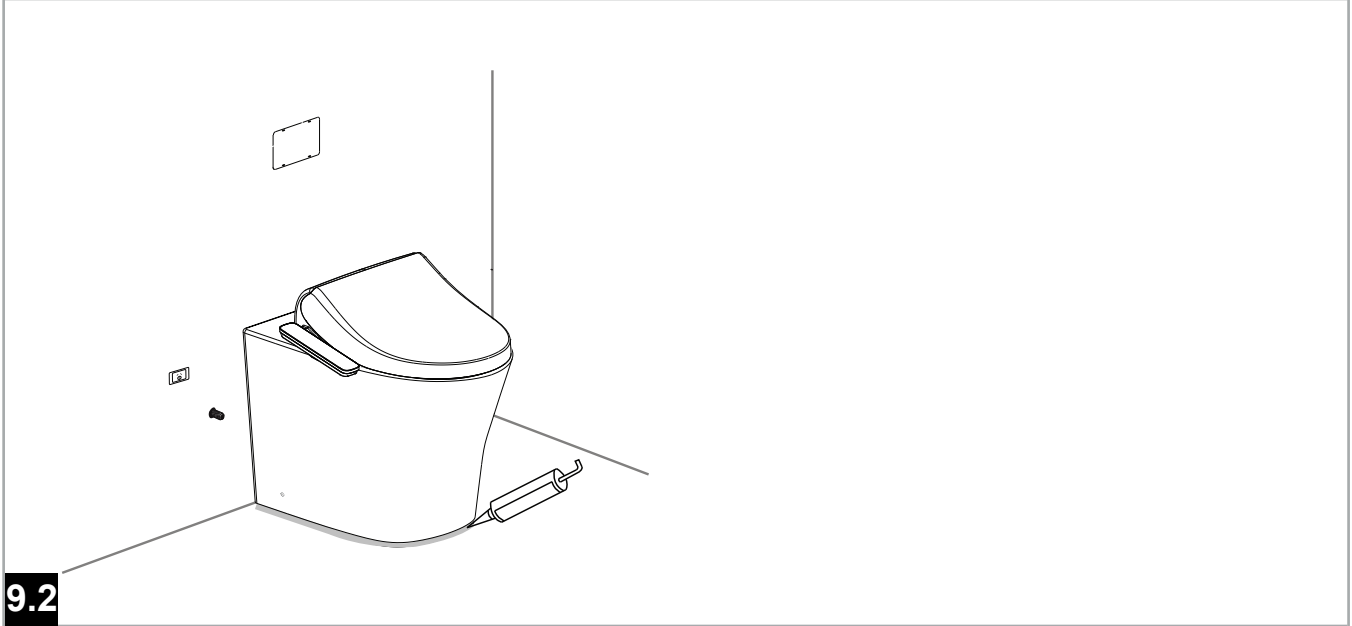

9.2

Installation on shall be accordance with AS/NZS3500.1 and AS/NZS3500.2.